

# *Casablanca*® millelumen®

## TET

- Ⓓ Elektrische Anschlüsse dürfen nur vom Elektrofachmann ausgeführt werden.
- ⒼⒷ Electrical connections may be carried out by professional electricians only.
- Ⓕ Les raccordements électriques doivent être effectués uniquement par un électricien qualifié.
- Ⓘ L'apparecchio d'illuminazione è sicuro solo se installato da personale qualificato.
- ⒴ Podłączenia elektryczne mogą być wykonywane tylko przez elektryków.
- Ⓔ La instalación debe realizarse por personal cualificado.
- Ⓔ *электрические соединения могут осуществляться только профессиональным электриком.*




# TET

## LED Austausch - Replacement Échange - Scambio - Intercambio


Casablanca®  
millelumen®



1 Zuerst Leuchte vom Stromnetz trennen  
Disconnect the luminaire from power supply  
Débranchez le luminaire de l'alimentation électrique  
Scollagare l'apparechio dall'alimentazione  
Desconecte la luminaria de la fuente de alimentación

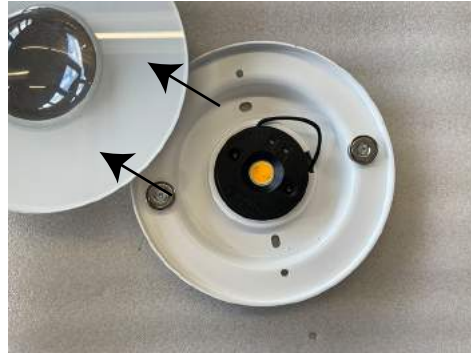

2

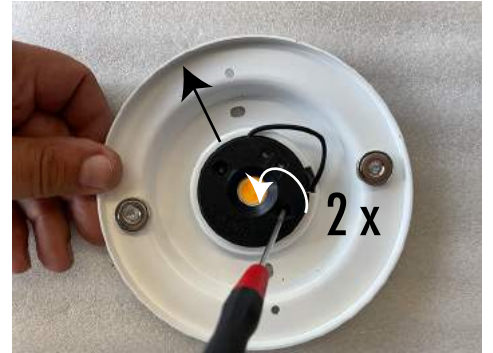

3



4




5



6



7

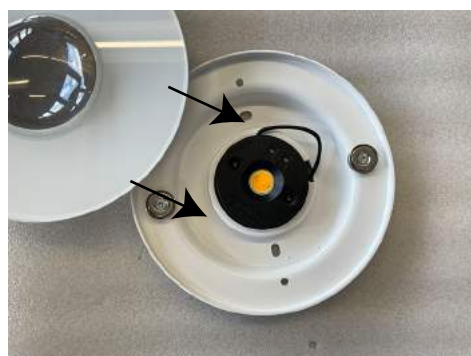

8



9

CE